

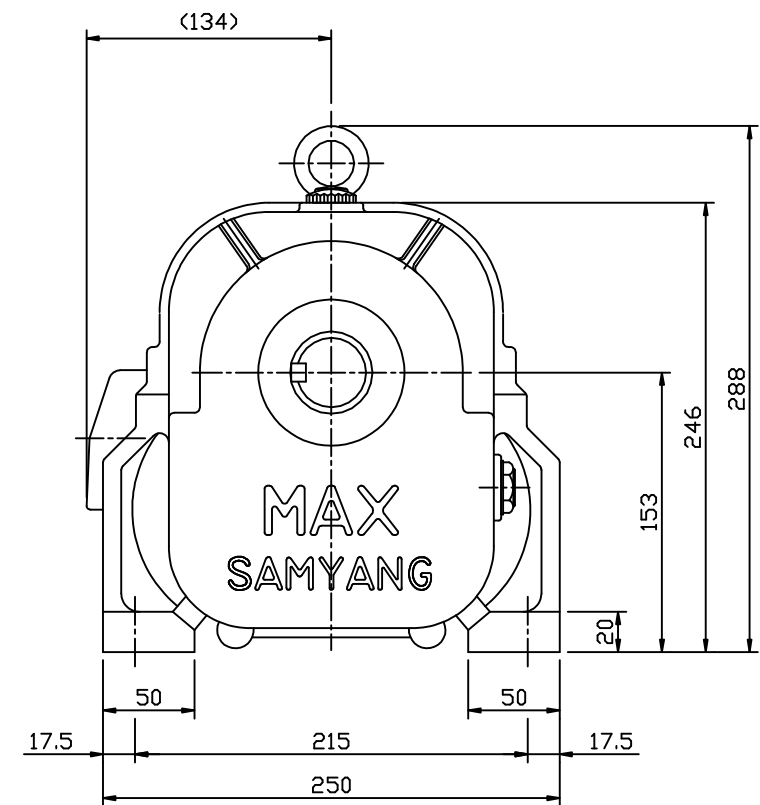
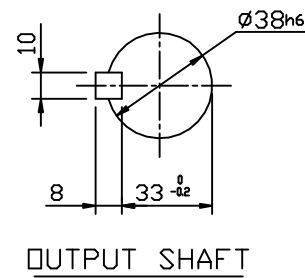


MATERIAL		Q'TY		By order
----------	--	------	--	----------

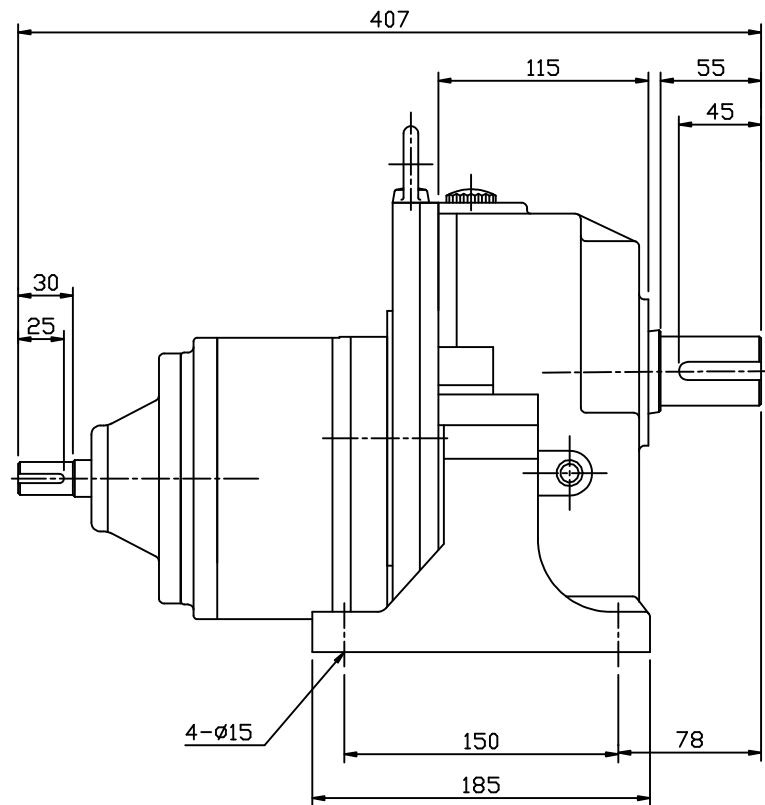

* 출력 TORQUE를 25Kg-m이하로 사용하여 주십시오.

NO.	REVISION	DATE	NAME

DATE	NAME	TITLE	SCALE
2001.8.13	강선미	MAX GEARED MOTOR L105+F153	1 / 1
CHECK		0.4KW-4P-3φ i=1/120 ~1/200	
APPROV			
SAMYANG		PART	SHEET
REDUCTION GEAR CO., LTD		DWG. NO. L153-004-A	