
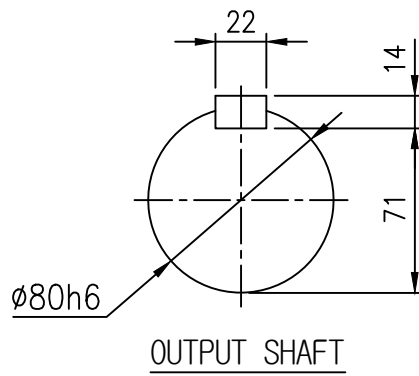


| NO. | REVISION | DATE | DESIGNED | CHECKED | APPROVED |
|-----|----------|------|----------|---------|----------|
| △   |          |      |          |         |          |
| △   |          |      |          |         |          |

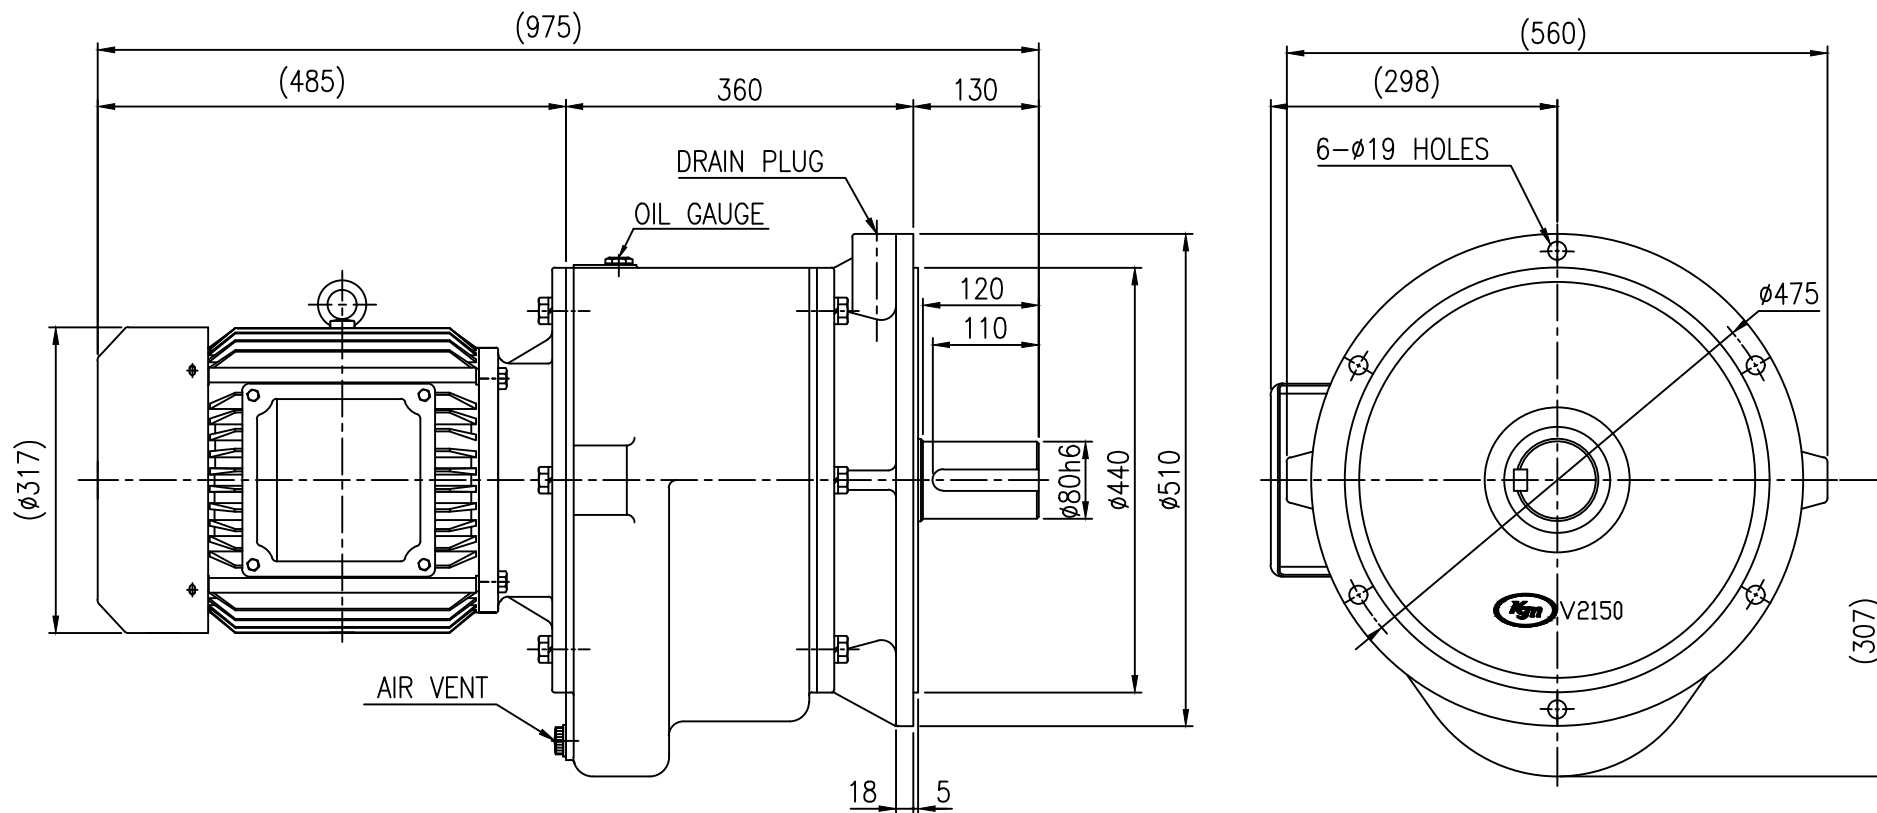

|             |                 |        |      |         |      |
|-------------|-----------------|--------|------|---------|------|
| KD<br>V3002 | CAPACITY(Kw)    | 11kw4P |      | 7.5kw6P |      |
|             | REDUCTION RATIO | 1/25   | 1/30 | 1/25    | 1/30 |
|             | OUTPUT R.P.M    | 72     | 60   | 48      | 40   |
|             | WEIGHT (Kg)     | 415    |      |         |      |

| TOOTH CHAMFERING | MODULE |      |     |              |               |             | 표기외 일반 공차      |
|------------------|--------|------|-----|--------------|---------------|-------------|----------------|
|                  | 5      | 5-15 | 15  |              |               |             |                |
| HQ. T            | C1     | 0.2  | 0.5 | 1.0          |               |             | 각도 : ±0.2°     |
|                  | C2     | 1.0  | 1.5 | 2.0          |               |             |                |
| HC & HQ. I       | C1     | 0.5  | 1.0 | 2.0          |               |             | CHAMFER: C1.0  |
|                  | C2     | 2.0  | 3.0 | 5.0          |               |             |                |
|                  |        |      |     | M<8(R0.1-1M) | M=8-15(R0.3M) | M>15(R0.3M) | FILLET: R1.0   |
|                  |        |      |     |              |               |             | 마무리: ∇         |
|                  |        |      |     |              |               |             | 1000 이상 : ±0.5 |

( )내의 치수는 다소 변경될수 있음.

|              |                                             |                                  |                                    |            |     |        |  |
|--------------|---------------------------------------------|----------------------------------|------------------------------------|------------|-----|--------|--|
| OUT LINE DWG |                                             |                                  |                                    |            |     |        |  |
| No.          | DESCRIPTION                                 | SPECIFICATION                    | MAT'L                              | Q'TY       | W/T | REMARK |  |
| TITLE SPEC.  | KDV GEARED MOTOR<br>11KW 4P IE3 I=1/25~1/30 |                                  | CUSTOMER KD V3002<br>STANDARD TYPE |            |     |        |  |
| DRAWN        | KSS                                         | SCALE                            | 1 / 1                              | UNIT       | mm  |        |  |
| DESIGN       | YHH                                         | DATE                             | 2020.11.30                         | PROJECTION | 1st |        |  |
| CHECKED      |                                             | REF. No.                         | KD V3002                           | REV. No.   |     |        |  |
| APPROVED     |                                             | DRAWING No.                      | KDV9002-15-25-30-OD                |            |     |        |  |
|              |                                             | (주) 케이 지 엠<br>KOREA GEARED MOTOR |                                    |            |     |        |  |

|          |
|----------|
| M5#0.8   |
| M6# 1    |
| M8#1.25  |
| M10#1.5  |
| M12#1.75 |
| M16# 2   |
| M18#2.5  |
| M20#2.5  |
| M22#2.5  |
| M24#3    |